




Load Graph & Control Data

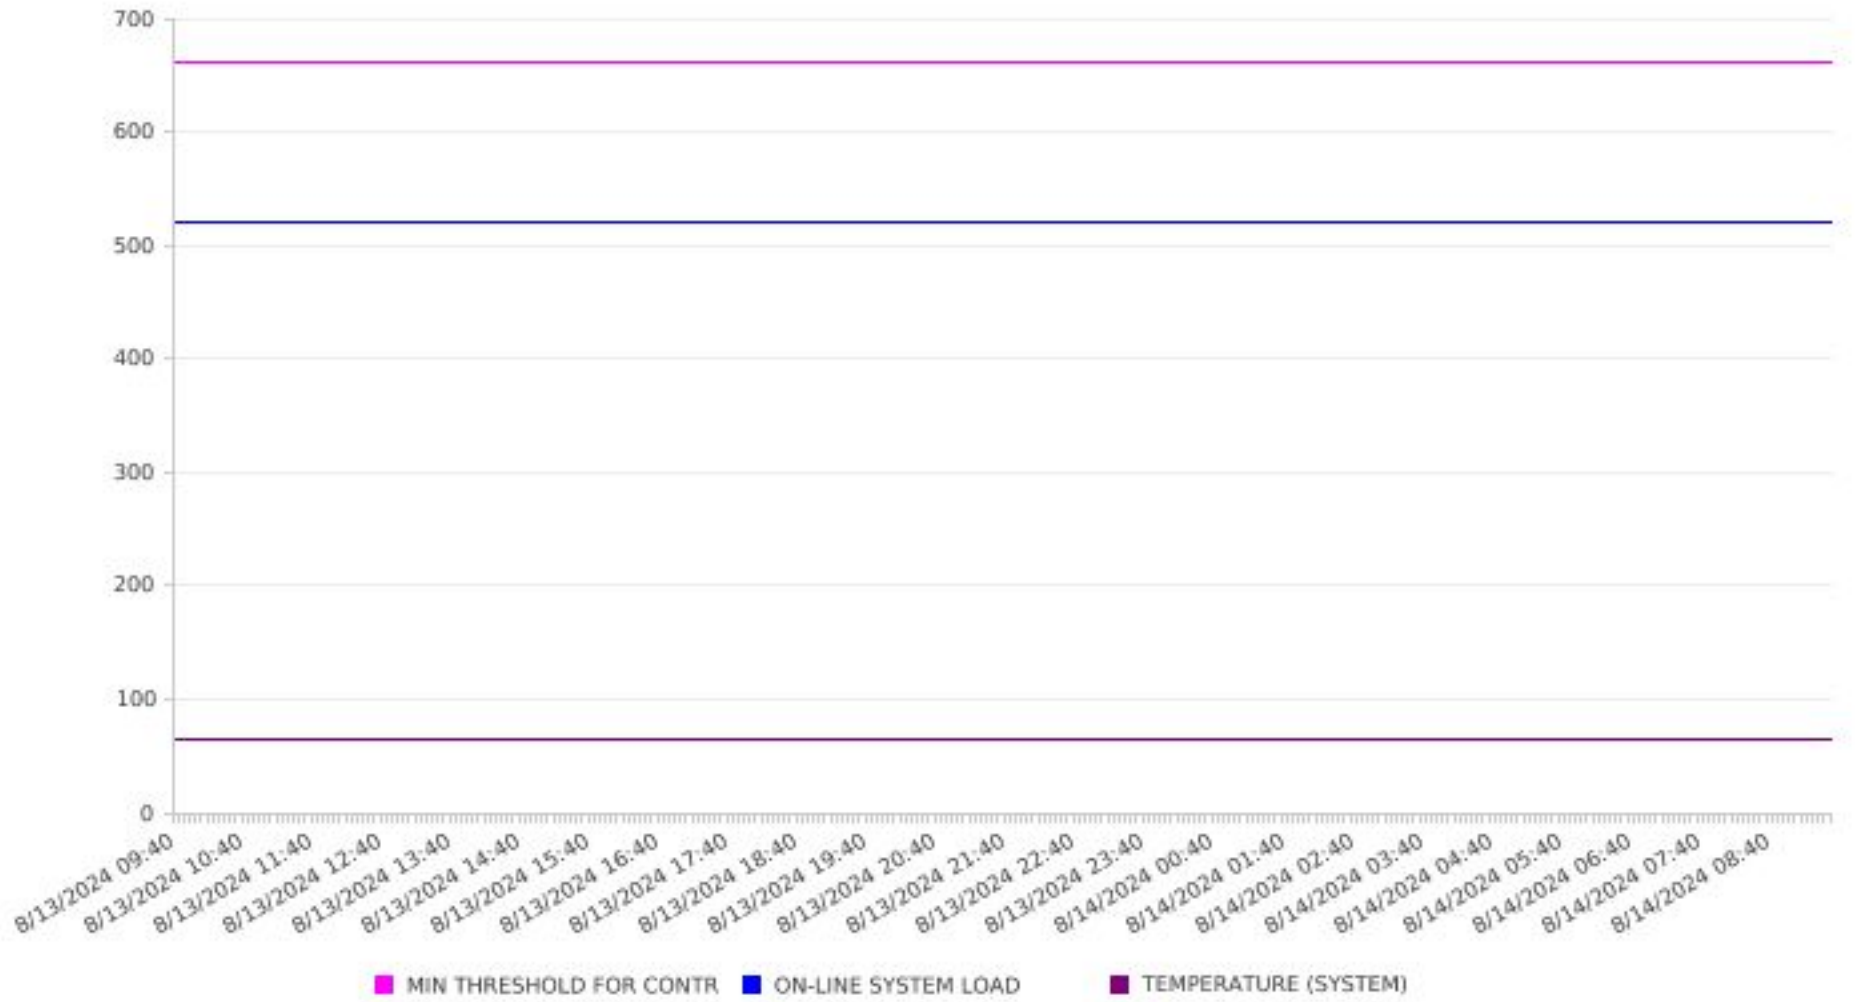

Peak MW Demand This Month	
Max Value	Max Occurence
663.8	08/02/2024 22:55

Valid MW Demand This Month	
Valid Value	Valid Occurence
565.4	04/01/2024 10:30

Estimated Load Control End Time			
IN2 */IR1 *		Other	
Hour	Minute	Hour	Minute
0	0	0	0

Load Type	Date/Time (Current)	Load Status
Air Conditioners (AIR *)	3/19/2024 14:04	ON
Demand Controllers (DM1 *)	4/2/2024 09:56	ON
Heat Storage Central (HSC *)	4/2/2024 07:30	OFF
Industrial 1 5/7 Alert (BI1 *)	3/19/2024 14:04	ON
Industrial 1 Voluntary (IN1 *)	4/2/2024 09:51	ON
Industrial 2 5/7 Direct Control (BI2 1-4)	3/19/2024 14:04	ON
Industrial 2 5/7 Direct Control (BI2 5-8)	3/19/2024 14:04	ON
Industrial 2 5/7 Direct Control (BI2 9-12)	3/19/2024 14:04	ON
Industrial 2 Direct Control (IN2 *)	4/2/2024 09:51	ON
Industrial Heat (IH1 *)	4/2/2024 09:56	ON
Irrigation 1-4 (IR1 1-4)	4/2/2024 09:44	ON
Irrigation 5-8 (IR1 5-8)	4/2/2024 09:44	ON
Irrigation 9-12 (IR1 9-12)	4/2/2024 09:44	ON
Water Heater 01 (WAT 1)	4/2/2024 07:57	ON
Water Heater 02 (WAT 2)	4/2/2024 08:08	ON
Water Heater 03 (WAT 3)	4/2/2024 08:26	ON
Water Heater 04 (WAT 4)	4/2/2024 08:35	ON
Water Heater 05 (WAT 5)	4/2/2024 08:48	ON
Water Heater 06 (WAT 6)	4/2/2024 08:58	ON
Water Heater 07 (WAT 7)	4/2/2024 09:13	ON
Water Heater 08 (WAT 8)	4/2/2024 09:20	ON
Water Heater 09 (WAT 9)	4/2/2024 09:29	ON
Water Heater 10 (WAT 10)	4/2/2024 09:38	ON
Water Heater 11 (WAT 11)	4/2/2024 10:00	ON
Water Heater 12 (WAT 12)	4/2/2024 10:02	ON